




# F4 Process Controller Installation and Operation Guide

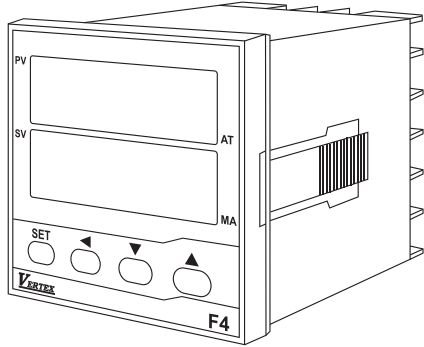

**Alarm Output** : 5A/240Vac (Resistive load)  
**Alarm Function** : Energized / De-energized with 0~30000 Sec. / Min. delay

- No alarm
- Process high alarm
- Process low alarm
- Deviation high alarm
- Deviation low alarm
- Inside deviation band alarm
- Outside deviation band alarm

**Alarm Mode** :

- Normal mode
- Standby mode
- Latch mode
- Standby and Latch mode

**Communication** :

- Interface : Half duplex based on EIA RS-485
- Protocol : ModBus RTU mode
- Data format :
  - Start bit : 1
  - Data bit : 8
  - Parity : None
  - Stop bit : 2
- Baud Rate : 2400, 4800, 9600, 19200 bps

**Power supply** : 100~240 Vac, 50/60 Hz / 24Vdc  
**Power consumption** : 4VA Max.  
**Common mode rejection ratio** : >80dB.  
**Operating temperature** : 0 to 50°C  
**Humidity** : 0 to 85% RH (Non-Condensing)  
**Electromagnetic compatibility (EMC)** : En 50081-2, En 50082-2  
**Dimension** : 48x48x55 mm (WxHxD).  
**Housing material** : ABS plastic. UL 94V0  
**Weight** : 100g

## 1. Introduction

### 1.1. Highlight Features

- Space saving, only 55mm panel depth required
- Higher sampling rate (100mS) results in better control performance
- Protect the load from thermal shock (unwanted rapid temperature rise) using the excellent ramp rate feature
- Protect the heating element from excess current during power-up using the soft start function
- Easy to read 0.4" / 10mm LED display showing SV/PV at a glance
- NEMA-4 IP65 front panel protection when used with panel gasket or IP63 without

### 1.2. Specification

- Input signal** : User programmable. refer to table 1.
- Thermocouple (T/C) : industry standard thermocouple types, J, K, T, E, B, R, S, N, C (ITS-90).
  - Pt100 : Excitation 180uA. 2 or 3 wire connection (ITS-90  $\alpha=0.00385$ ).
  - Voltage : -60mVdc to 60mVdc or -10Vdc to 10Vdc.
  - Current : 0mA to 24mA
- Measuring range** : User programmable. Maximum range refer to table 1.  
**Measuring accuracy** : refer to Table 1. the accuracy is tested under the operating condition of 24°C±3°C.

Input signal	Maximum Range	Accuracy
Thermocouple J	-50 to 1000°C (-58 to 1832°F)	±1°C
Thermocouple K*	-50 to 1370°C (-58 to 2498°F)	±1°C
Thermocouple T	-270 to 400°C (-454 to 752°F)	±1°C
Thermocouple E	-50 to 750°C (-58 to 1382°F)	±1°C
Thermocouple B	0 to 1800°C (32 to 3272°F)	±2°C (Note1)
Thermocouple R	-50 to 1750°C (-58 to 3182°F)	±2°C
Thermocouple S	-50 to 1750°C (-58 to 3182°F)	±2°C
Thermocouple N	-50 to 1300°C (-58 to 2372°F)	±2°C
Thermocouple C	-50 to 1800°C (-58 to 3272°F)	±2°C
Pt100 (DIN)	-200 to 850°C (-328 to 1562°F)	±0.2°C
Pt100 (JIS)	-200 to 600°C (-328 to 1112°F)	±0.2°C
mA	-24mA~24mA	±4μA
mV	-60mV~60mV	±0.01mV
Voltage	-10V~10V	±2mV

#### \*Factory Setting

**Note 1** : Accuracy is not guaranteed between 0 and 400°C (0 and 752°F) for type B.  
**Table 1 Input Signal**

**Sampling rate** : 100mS

#### Control Output :

- Relay output : 5A/240Vac (Resistive load)
  - Pulsed Voltage output : DC 0/24V (Resistive load 1.2K ohms Min.)
  - Current output : 4~20mA (Resistive load 600 ohms Max.)
  - Voltage output : 0~10V (Resistive load 600 ohms Min.)
- Control Mode** : PID with auto-tune, P with manual reset or On/Off with hysteresis available.
- Proportional Band : 0.0~300.0% (0.0 % = On/Off mode)
  - Integral Time : 0.0~3000 sec.
  - Derivative Time : 0.0~1000 sec.
  - Cycle Time : 0~60 sec.
  - Hysteresis : 0~9999

#### Ramp Function :

- Ramp rate : 0~9999 unit/minute or unit/second (0 = disable the ramp function)

### 1.3. Ordering information

Input	Code	Output 1 (Alarm2)	Code	Alarm 1 (Output2)	Code	Communication	Code	Power Supply	Code	Protection	Code
T/C	T	Relay	R	Alarm 1	A	None	N	100~240 Vac	A	IP 63	3
PT100 (RTD)	D	SSR	P	Relay	R	RS-485	C	24 Vdc	D	IP 65	6
0-60mV DC	L	4~20mA	M								
0-10V DC	V	0-10V	V								
0-24mA DC	M	Other	O								
		Alarm 2	A								

## 2. Installation

### 2.1. Panel mounting

1. Prepare the panel cutout with proper dimensions (45.5<sup>+0.5</sup><sub>-0.0</sub> X 45.5<sup>+0.5</sup><sub>-0.0</sub> mm)
2. Insert the controller into the panel cutout from the front of the panel.
3. Secure the controller by pushing the mounting bracket into the controller from the rear side.
4. Tighten the screws of the mounting bracket slightly if the controller is not firmly secured

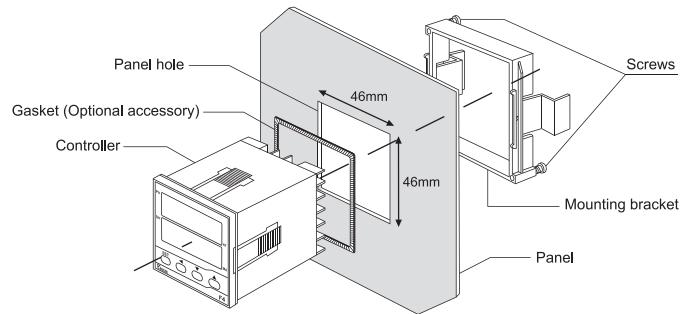
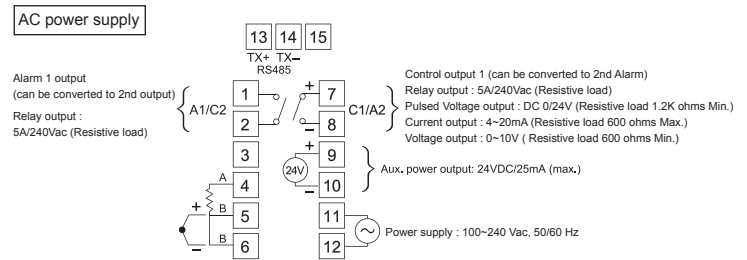


Figure 1. Panel mounting

### 2.2. Connections and wiring



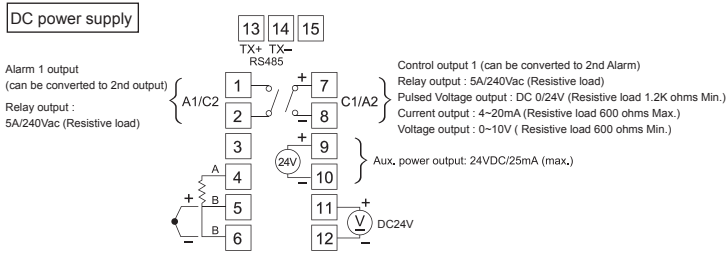


Figure 2. Terminal connections

Wiring precaution:  
Inverter, mechanical contact relays, arc welders, and ignition transformers are all common sources of electrical noise in an industrial environment, so always keep signal wires away from those noise-generating devices.

### 3. Operation

#### 3.1. Front panel description

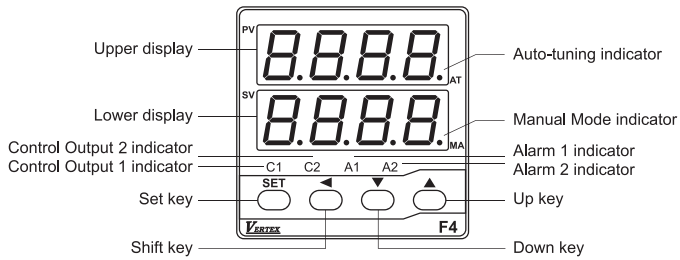


Figure 3. Front panel description

- PV ( Upper display ) : Display the process Value, parameter index code or error code
- SV ( Lower display ) : Display the set point value or the set value of parameter
- C1 : Control output 1 indicator
- C2 : Control output 2 indicator
- A1 : Alarm 1 indicator
- A2 : Alarm 2 indicator
- AT : Auto-tuning indicator (The right-most decimal point of upper display)
- MA : Manual mode indicator (The right-most decimal point of lower display)

#### Keypad description

- SET key : Use to menus navigation and set value registration
- Shift key : Shift the digit of numeral
- Down key : Decreases the parameter value or change the setting
- Up key : Increases the parameter value or change the setting
- SET + Shift key for 2 sec. : Enter set up mode
- SET + up key : Return to PV/SV display
- Shift + Down key on powering up : set all parameters to default setting

#### 3.2. Powering up procedure

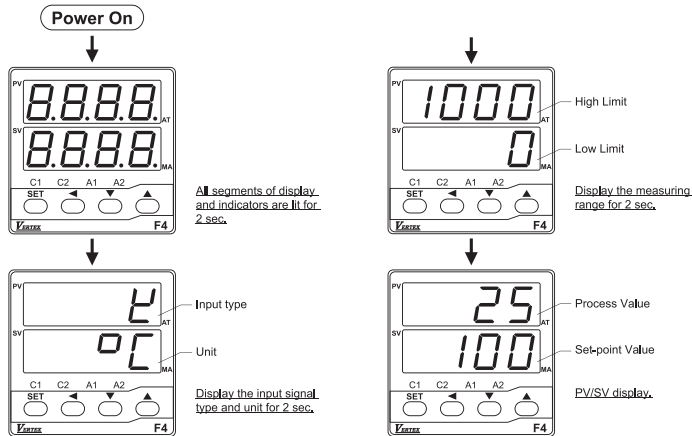


Figure 4. Powering up procedure

#### 3.3. Configuration

##### 3.3.1. Menu Flowchart

After powering up procedure, the controller stays in PV/SV display. The upper display shows the process value (measuring value) and the lower display shows the set point value (target value). All the configurable parameters are located in different levels and can be accessed by keypad operation as shown in figure 5.

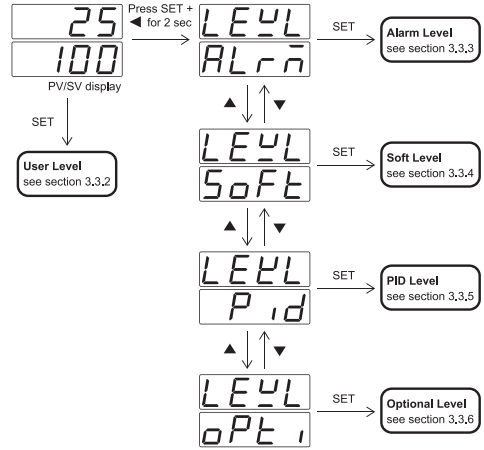


Figure 5. Menu flowchart

##### 3.3.2. User Level

Display	Description	Range	Default	Unit
PvOF	Process value offset correction	-1000~1000 ( dP =0000) -100.0~100.0 ( dP =000.0) -10.00~10.00 ( dP =00.00) -1.000~1.000 ( dP =0.000)	0	Unit
oUeL	Control output percentage	0.0~100.0%	N/A	%
rUn	Control mode	oFF : Off on : On Rt1 : AT1 Rt2 : AT2 rAn : Man	On	N/A

##### Process value offset correction

The value to be added to the PV to correct the sensor offset error.

##### Control output percentage

In Auto mode ( rUn = on ), it shows the percentage of power applied to the control output. In Manual mode ( rUn = rAn ), the upper display will show the process value (PV) and "oUeL" alternately and the "MA" indicator is lit. The value of percentage can be changed manually.

##### Control mode

Select the control mode to be

- Off – Standby mode. Both control output and alarm are turned off.
- On – Auto mode (closed loop control). In this mode, the control output percentage is determined by PID algorithm or ON/OFF action.
- AT1 – Auto-tuning mode 1. In this mode, the controller will tune the PID parameters automatically at SV. The process will oscillate around the SV during AT1 process (Figure 6). Use AT2 mode if overshooting beyond the normal process is likely to cause damage.
- AT2 – Auto-tuning mode 2. In this mode, the controller will tune the PID parameters automatically at (SV-10%). The process will oscillate around (SV-10%) during AT2 process (Figure 6).
- Man – Manual mode (open loop control). In this mode, the control output can be set manually.

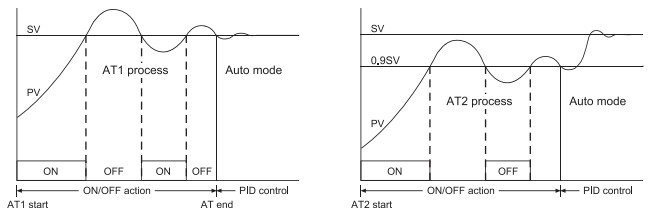


Figure 6. Auto-tuning Process

##### 3.3.3. Alarm Level

Display	Description	Range	Default	Unit
RISP	Alarm 1 set-point	-1999~9999 ( dP =0000) -199.9~999.9 ( dP =000.0) -19.99~99.99 ( dP =00.00) -1.999~9.999 ( dP =0.000)	10	unit
R1HY	Alarm 1 hysteresis	0~9999 ( dP =0000) 0~999.9 ( dP =000.0) 0~99.99 ( dP =00.00) 0~9.999 ( dP =0.000)	0	unit
R1FU	Alarm 1 function	RoFF : A.oFF RH : A.Hi RLo : A.Lo RdIH : A.diH RdiL : A.diL RbdH : A.bdH RbdL : A.bdL boFF : b.oFF bH : b.Hi	A.diH	N/A

		<i>bLo</i> : b.Lo <i>bdHi</i> : b.diH <i>bdLi</i> : b.diL <i>bbdH</i> : b.bdH <i>bbdL</i> : b.bdL		
<i>Rid</i>	Alarm 1 mode	<i>none</i> : None <i>Stdy</i> : Stdy <i>LATH</i> : LATH <i>StLA</i> : StLA	None	N/A
<i>R1dt</i>	Alarm 1 delay time	oFF, 00.01~99.59	oFF	HH.MM/MM.SS
<i>R2SP</i>	Alarm 2 set-point*	Same as Alarm 1 set-point	10	Unit
<i>R2HY</i>	Alarm 2 set hysteresis*	Same as Alarm 1 set hysteresis	0	Unit
<i>R2FU</i>	Alarm 2 function	Same as Alarm 1 function	A.diL	N/A
<i>R2nd</i>	Alarm 2 mode*	Same as Alarm 1 mode	None	N/A
<i>R2dt</i>	Alarm 2 delay time*	Same as Alarm 1 delay time	oFF	HH.MM/MM.SS

\*All the alarm 2 parameters are only shown when the control output is set as 2nd alarm action.

**Alarm 1 set-point, Alarm 2 set-point**

The set point of alarm even

**Alarm 1 hysteresis, Alarm 2 hysteresis**

The hysteresis of alarm action

**Alarm 1 function, Alarm 2 function**

Select the alarm function

A.oFF – Alarm action off.

A.Hi – Process high alarm with Form A contact

A.Lo – Process low alarm with Form A contact

A.diH – Deviation high alarm with Form A contact

A.diL – Deviation low alarm with Form A contact

A.bdH – Deviation band high alarm with Form A contact

A.bdL – Deviation band low alarm with Form A contact

b.oFF – Alarm action off

b.Hi – Process high alarm with Form B contact

b.Lo – Process low alarm with Form B contact

b.diH – Deviation high alarm with Form B contact

b.diL – Deviation low alarm with Form B contact

b.bdH – Deviation band high alarm with Form B contact

b.bdL – Deviation band low alarm with Form B contact

- ☀ Alarm indicator lite
- Alarm indicator off

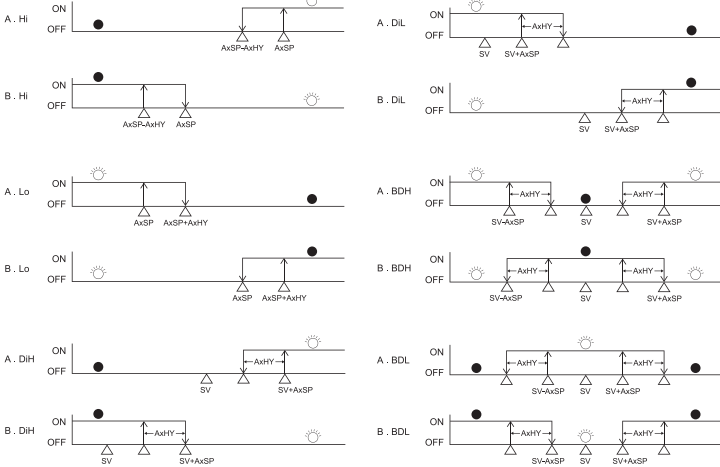


Figure 7. Alarm function

**Alarm 1 mode, Alarm 2 mode**

Select the alarm mode as

None – Disable the alarm mode

Stdy – Standby mode. When selected, prevents an alarm on power up. The alarm is active after alarm condition has been cleared and then alarm occurs again.

LATH – Latch mode. When selected, the alarm output and indicator latch as the alarm occurs. The alarm output and indicator will not change its state even if the alarm condition has been cleared unless the power is off.

StLA – Both standby and Latch mode are applied. Figtr 8 shows the result of different alarm modes applied on Deviation Band High Alarm with alarm hysteresis set to 0.

**Alarm 1 delay time, Alarm 2 delay time**

Alarm delay time is set to postpone the alarm action by the setting time.

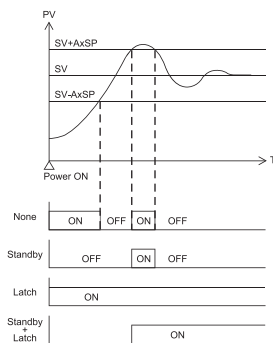


Figure 8. Alarm Mode

**3.3.4. Soft Level**

Display	Description	Range	Default	Unit
<i>rRnP</i>	Ramp rate	oFF, 1~9999 (0.1~999.9)	oFF	Unit / sec.(min)
<i>SoFt</i>	Soft start time	oFF, 00.01~99.59	oFF	Minutes : Seconds

**Ramp rate**

The controller can act as either a fixed set point controller or as a single ramp controller. If the ramp rate is set to a value other than "oFF", the process will increase or decrease at the setting rate during initial power up or with set point change. The ramp rate is in degree per min. or sec. depends on the time scale set in PTME.




Figure 9. Ramp Function

**Soft start time**

Soft start time can be programmed in situation where 100% output is not allowed at power up. The time duration for the output to rise from 0% to 100% is defined as soft start time.




Figure 10. Soft Start

**3.3.5. PID Level**

Display	Description	Range	Default	Unit
<i>Pb</i>	Proportional band	0.0~300.0	5.0	%
<i>ti</i>	Integral time	oFF, 1~3000	240	Sec.
<i>td</i>	Derivative time	oFF, 1~1000	60	Sec.
<i>nr</i>	Manual reset	0.0~51.0	0.0	%
<i>Ar</i>	Anti-reset windup	0.0~100.0	50.0	%
<i>HYS</i>	Hysteresis for ON/Off control	0~1000 (0.0~100.0)	0	uint
<i>Ct</i>	Cycle time	0~60	15	Sec.
<i>CPb</i>	Cooling proportional band	0.0~300.0	5	%
<i>db</i>	Dead band	-1000~1000(-100.0~100.0)	0	°C, °F or Engineering Unit
<i>CCt</i>	Cooling cycle time	1~60	15	Sec.

**Proportional band**

Set the proportional band in percentage of SPAN (High limit - Low limit). It can be set automatically by auto-tuning process.

**Integral time**

Set the integral time constant in repetitions per second. It can be set automatically by auto-tuning process.

**Derivative time**

Set the derivative time constant in second. It can be set automatically by auto-tuning process.

**Manual reset**

For PID control, this value is set automatically after auto-tuning process. For P control, it is used to compensate the deviation between process value and set point.

**Anti-reset windup**

The anti-reset windup (ARW) inhibits the integral action until the process value is within the band thus reducing overshoot on start-up. The ARW can be set automatically by auto-tuning process and then can be changed manually if required

**Hysteresis for ON/OFF control**

In ON/OFF control (Proportional band set to 0.0%), the control output turns On/Off with respect to the set point. Therefore, the control output would change frequently in response to a slight change in process value. This might shorten the service life of the output device. To prevent this, a hysteresis is provided in the ON/OFF control.

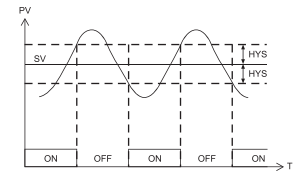


Figure 11. ON/OFF Control Action

**Cycle time**

Set the control output cycle time. It is recommended to set to 15 sec. for Relay output and set to 1 sec. for pulsed voltage output.

**Cooling proportional band**

Set the cooling proportional band in percentage of SPAN (High limit - Low limit). It can be set automatically by auto-tuning process. Set to 0.0 for ON/OFF control mode.

**Dead band**

This setting defines the area in which both heating and cooling outputs are inactive, known as dead band, or the area in which they are both active, known as overlap. A positive value results in a dead band, while a negative value results in an overlap.

**Cooling cycle time**

Set the cooling output cycle time. It is recommended to set to 15 sec. for Relay output.

**3.3.6. Option Level**

Display	Description	Range	Default	Unit
<i>TYPE</i>	Input signal type	<i>J</i> : J type <i>K</i> : K type <i>T</i> : T type <i>E</i> : E type <i>B</i> : B type <i>R</i> : R type	K type	N/A
<i>SEAL</i>	Low scale for linear input	-1999~9999	0	Unit
<i>SEAH</i>	High scale for linear input	-1999~9999	1000	Unit
<i>CUT</i>	Cut-off function	<i>none</i> : None <i>Lo</i> : Low <i>Hi</i> : High <i>HiLo</i> : High/Low	None	N/A

Unit	Unit	°C : °C °F : °F Eng : Engineer	°C	N/A
dP	Decimal point	0000 000.0 00.00 (for linear input signal only) 0.0000 (for linear input signal only)	0000	N/A
Act	Control action	Dir : Dir Rev : Rev	Rev	N/A
LoLt	Low limit	Refer to table 1.	0	Unit
HiLt	High limit	Refer to table 1.	1000	Unit
Filt	Digit filter	0.0~99.9	0.0	Sec.
PtAE	Time scale	HH.MM : HH.MM MM.SS : MM.SS	HH.MM	N/A
ErOP	Error protection	0000 0001 0010 0011	0000	N/A
LoCL	Security lock	0000 0001 0010 0011 0100 0101 0110	0110	N/A
SpOF	Setpoint offset	-1999~9999 ( dP =0000) -199.9~999.9 ( dP =000.0) -19.99~99.99 ( dP =00.00) -1.999~9.999 ( dP =0.000)	0	Unit
Id	Communication ID	1~247	247	N/A
Baud	Baud rate	2.4K : 2.4K 4.8K : 4.8K 9.6K : 9.6K 19.2K : 19.2K	19.2K	bps

**Input signal type**

Select the input signal type. The available input signal types are :

- Thermocouple : J K T E B R S N C
- RTD : PT100 (JIS standard) or PT100 (DIN standard)
- Linear : 0~24mA, -60~60 mV or 0~10 V

Please note that the internal gaps on the main board of F4 controller should be configured in accordance with input signal.

Thermocouple	G1	GA1	GB1	GY
RTD	Linked	Linked	Open	Open
0~24 mA	X	Linked	Open	Linked
-60~60 mV	X	Linked	Open	Open
-10~10 V	X	Open	Linked	Open

X : don't care

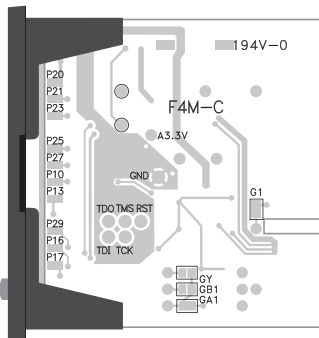


Figure 12. Gaps Allocation

**Low scale for linear input**

Select the low scale corresponding to low linear input signal. The default low linear input signal (INL) for mA, mV and V is 4.00mA, 0.00mV and 0.00V separately. This parameter is only showed when the input signal type is set to linear. (See also the cut-off function for further detail)

**High scale for linear input**

Select the high scale corresponding to high linear input signal. The default low linear input signal (INH) for mA, mV and V is 20.00mA, 50.00mV and 10.00V separately. This parameter is only showed when the input signal type is set to linear. (See also the cut-off function for further detail)

**Cut-off function**

The Cut-off function is used to limit the process value of linear input signal within the boundary whenever the input signal is out of the high/low limit range (set by HiLt and LoLt). The cut-off function can be set to "Low", "High" or "High/Low", set to "None" disables the cut-off function. The cut-off function has no effect for input signal other than linear input.




Figure 13. Scale and Cut-off Function

Range: 0 ~ 3

Unit: N/A

$$PV = \frac{IN - INL}{INH - INL} (SCAH - SCAL) + SCAL$$

Where

IN: the linear input signal.

INH: the high calibration of linear input signal. It is set in calibration parameters (mAL, mVL and VL).

INL: the low calibration of linear input signal. It is set in calibration parameters (mAH, mVH and VH).

Example:

For a 4~20mA input signal, the INL is set by mAL=4.00mA and the INH is set by mAH=20.00mA.

Set SCAL=0.0 SCAH=100.0 (Of course, you may select other scale value and decimal point to alter the resolution) and LoLt=0.0 HiLt=100.0.

For a 12mA input, the PV will be 50.0.

For a 22mA input, the PV will be 112.5 with cut-off function set to "None" or 100.0 with cut-off function set to "High" or "High/Low".

For a 0mA input, the PV will be -25.0 with cut-off function set to "None" or 0.0 with cut-off function set to "Low" or "High/Low".

**Unit**

Select the process value indication in °C or °F when the input signal type is set to thermocouple or PT100. Select engineer unit for linear input (mA, mV or V).

**Decimal point**

Select the decimal point position. The setting 00.00 and 0.000 is available for linear input only.

**Control action**

Dir - Direct action used for cooling process

Rev - Reverse action used for heating process

**Low limit**

Set the low limit of measuring range. When the PV goes below the low limit, the PV display flashing indicates a low limit error. The control output and alarm will be set according to the Error Protection.

**High limit**

Set the high limit of measuring range. When the PV goes beyond the high limit, the PV display flashing indicates a high limit error. The control output and alarm will be set according to the Error Protection.

**Digit filter**

Set the time constant for digit filter (the first order filter). It is useful when the process value is too unstable to be read.

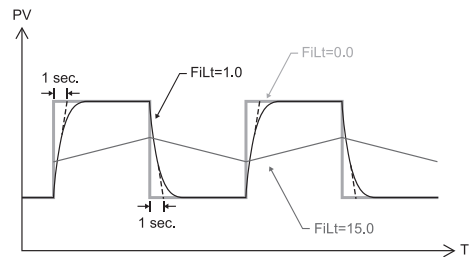


Figure 14. Digit Filter

**Time scale**

Set the time scale used for alarm delay time and ramp rate.

HH.MM - The alarm delay time is in hour and minute / The ramp rate is in per minute.

MM.SS - The alarm delay time is in minute and second / The ramp rate is in per second.

**Error protection**

Set the control output and alarm status whenever an error occurred. (refer to 4 Error Message)

Error protection	A1 / C2	C1 / A2
0000	OFF	OFF
0001	OFF	ON
0010	ON	OFF
0011	ON	ON

**Security lock**

The security lock is useful to lock out the parameters from unauthorized changed

Security lock	
0000	Only the security lock is open to change, all other parameters are locked
0001	Only the security lock and set point value is changeable. all the other parameters are locked
0010	The user level is open to change.
0011	The user and alarm levels are open to change.
0100	The user, alarm, and soft levels are open to change.
0101	The user, alarm soft and PID levels are open to change.
0110	All parameters are open to change.

**Set point offset**

Shift the set point value with an offset. The actual control target is shifted with this offset from set point value but not added to SV display.

**Communication ID**

Set the ID number in the communication network

**Baud rate**

Set the communication baud rate.

#### 4. Error Message

Display	Error Description	Correction
<i>oPEr</i>	Sensor break or open	<ol style="list-style-type: none"><li>1. Check the sensor is connected and input signal type is selected correctly.</li><li>2. Replace the sensor</li></ol>
<i>RdEr</i>	Input signal has out of A/D converter range	<ol style="list-style-type: none"><li>1. Check the sensor is connected and input signal type is selected correctly.</li><li>2. Replace the sensor.</li><li>3. Return to the supplier for repairing</li></ol>
<i>EPEr</i>	The content of EEPROM is corrupt	<ol style="list-style-type: none"><li>1. Return to default setting by pressing shift and down keys simultaneously while power on. And reconfigure the parameters</li><li>2. Return to the supplier for repairing</li></ol>
<i>RtEr</i>	Fail to complete the auto-tuning process within 2 hours	<ol style="list-style-type: none"><li>1. Retry the auto-tuning again.</li><li>2. Improve the control process to have fast response or use manual tuning instead of auto-tuning</li></ol>
Flashing	The PV is out of range	<ol style="list-style-type: none"><li>1. Check the sensor is connected and input signal type is selected correctly</li><li>2. Check the polarity of sensor is connected correctly</li><li>3. Check the high/low limit is set properly.</li><li>4. Replace the sensor</li></ol>